

8

7

6

5


4

3



2

1

H
G
F
E
D
C
B
A

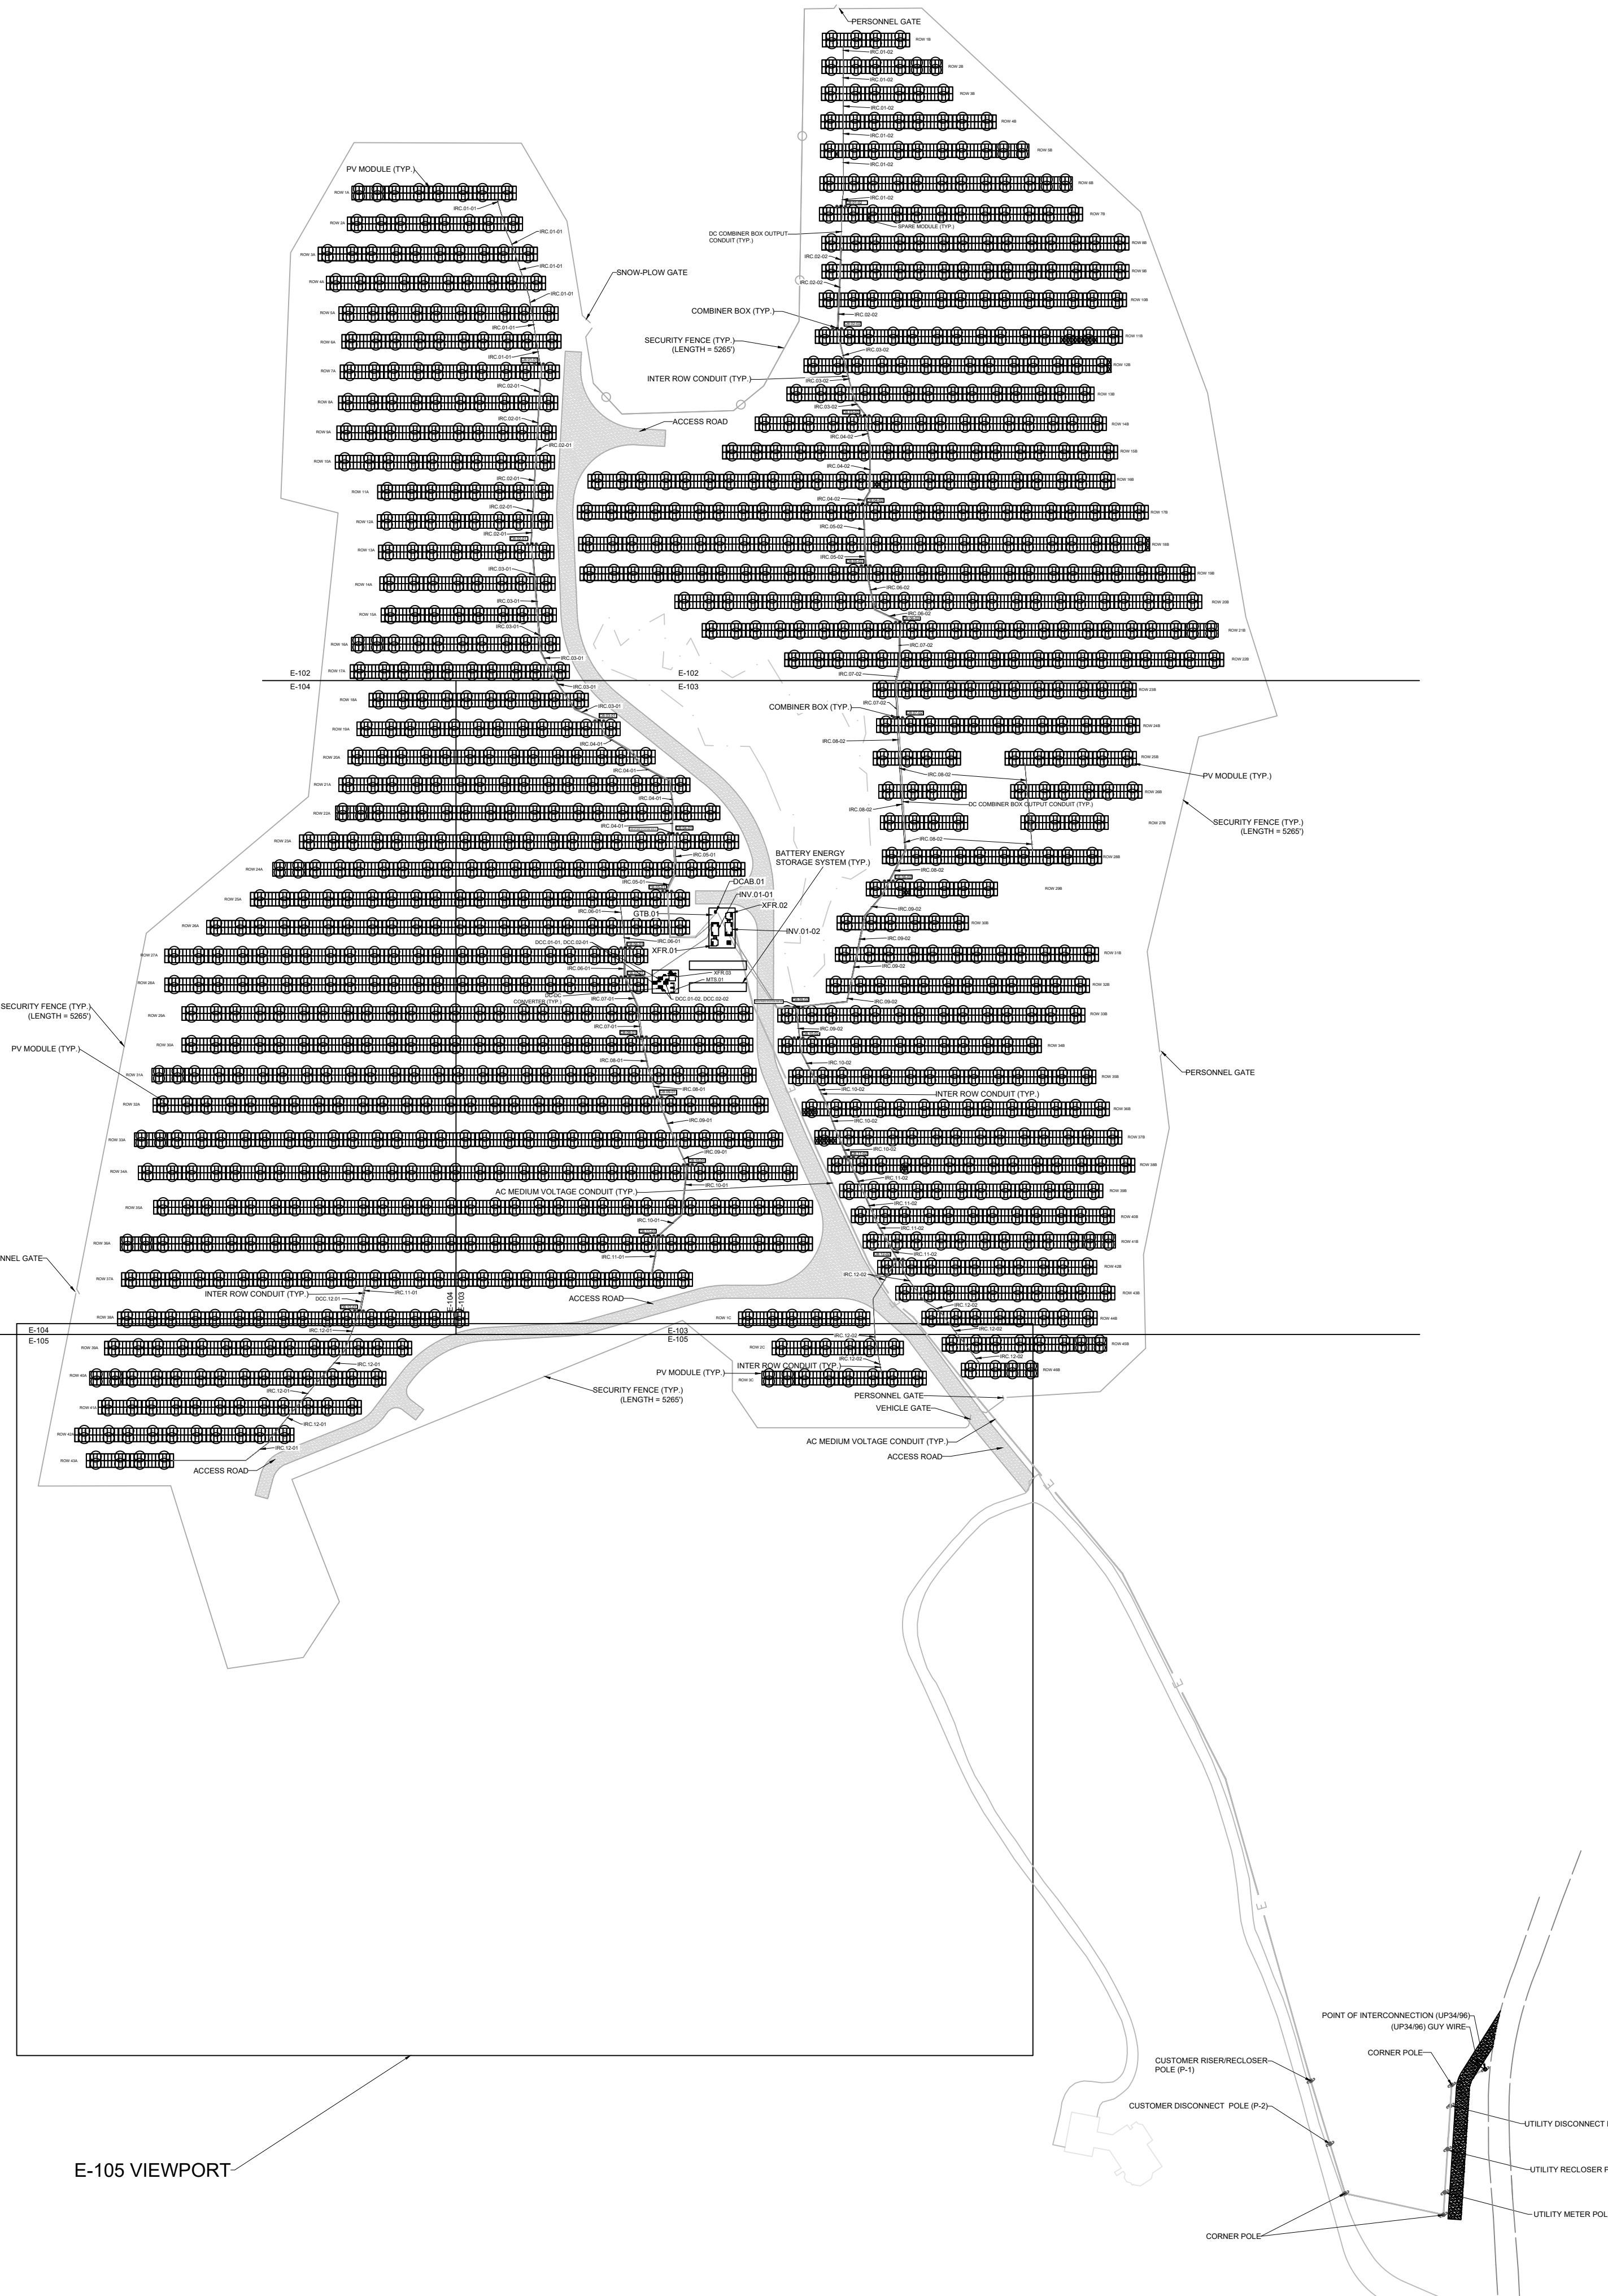

- NOTES:**
- DC & AC CONDUIT TRENCH FINAL LOCATIONS AND ROUTING TO BE COORDINATED WITH NEXAMP, ELECTRICAL CONTRACTOR, AND SITE CONTRACTOR.
 - KEEP TRENCHING THE MIN. DISTANCE FROM RACKING FOUNDATIONS AS REQUIRED BY RACKING MANUFACTURER SPECIFICATIONS AND MANUAL.
 - INTER-ROW CONDUIT LOCATIONS SHALL BE INSTALLED AS INDICATED IN DRAWING UNLESS CHANGE APPROVED BY NEXAMP. SIZE AND QUANTITY OF INTER-ROW CONDUIT SHALL BE DETERMINED BY ELECTRICAL CONTRACTOR PER NEC REQUIREMENTS. MAX SIZE FOR INTER-ROW CONDUIT SHALL BE 2".
 - ANY BREAKS BETWEEN RACK TABLES SHALL BE BONDED TO ADJACENT RACK TABLE. EACH RACK ROW SHALL BE BONDED TO A COMBINER BOX OR STRING INVERTER GROUNDING BUS BAR. USE #6 PV RATED WIRE Cu WITH MANUFACTURER REQUIRED GROUNDING LUG. ALL INTER-ROW CONDUIT SHALL CONTAIN AN EQUIPMENT GROUNDING CONDUCTOR PER NEC REQUIREMENTS.
 - HANDHOLES SHALL BE PROVIDED AND INSTALLED PER NEC REQUIREMENTS AND NEXAMP SPECIFICATIONS. QUANTITY AND LOCATIONS TO BE DETERMINED BY CONTRACTOR.

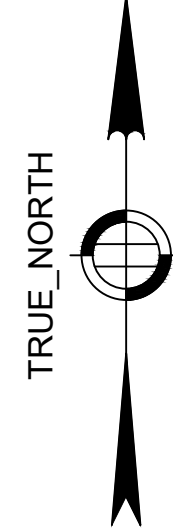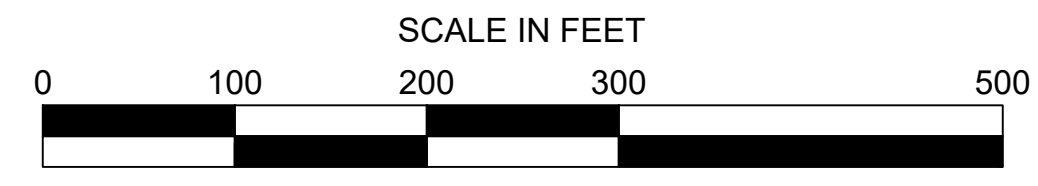

101 Summer Street, Boston, MA 02110
Tel: (617) 431-1440 Fax: (978) 416-2525 Web: nexamp.com

Rev	Issued For	Date
A	Bid Set	10/16/2019
A	Permit Set	10/25/2019
B	Construction Set	12/5/2019
C	Construction Set	03/03/2020
D	Construction Set	08/12/2020
E	Construction Set	09/11/2020
F	Construction Set	09/16/2020
G	Construction Set	10/14/2020

P.E. seal/Consultant:

06428
Conway Solar LLC.
2394 Main Poland Road
Conway, MA 01341

Electrical Site Plan (Overview)
Drawn by: L. Kamguia Scale: 1" = 100' Approved by: S. Petrarca

Dwg No: **E-101** Size: D Sheet Rev: **G**

8

7

6

5


4

3

2

1



Company Confidential - This drawing or print is the property of Nexamp, Inc. and is subject to return on request. The design concepts and information contained herein are proprietary to Nexamp, Inc. and its subsidiaries and are submitted in confidence. They are not transferable and must be used only for the purpose for which the Drawing/print is expressly loaned. They must not be disclosed, reproduced detrimental to the interest of Nexamp, Inc. All patent rights are reserved unless they are expressly assigned in writing by a duly authorized representative of Nexamp, Inc.

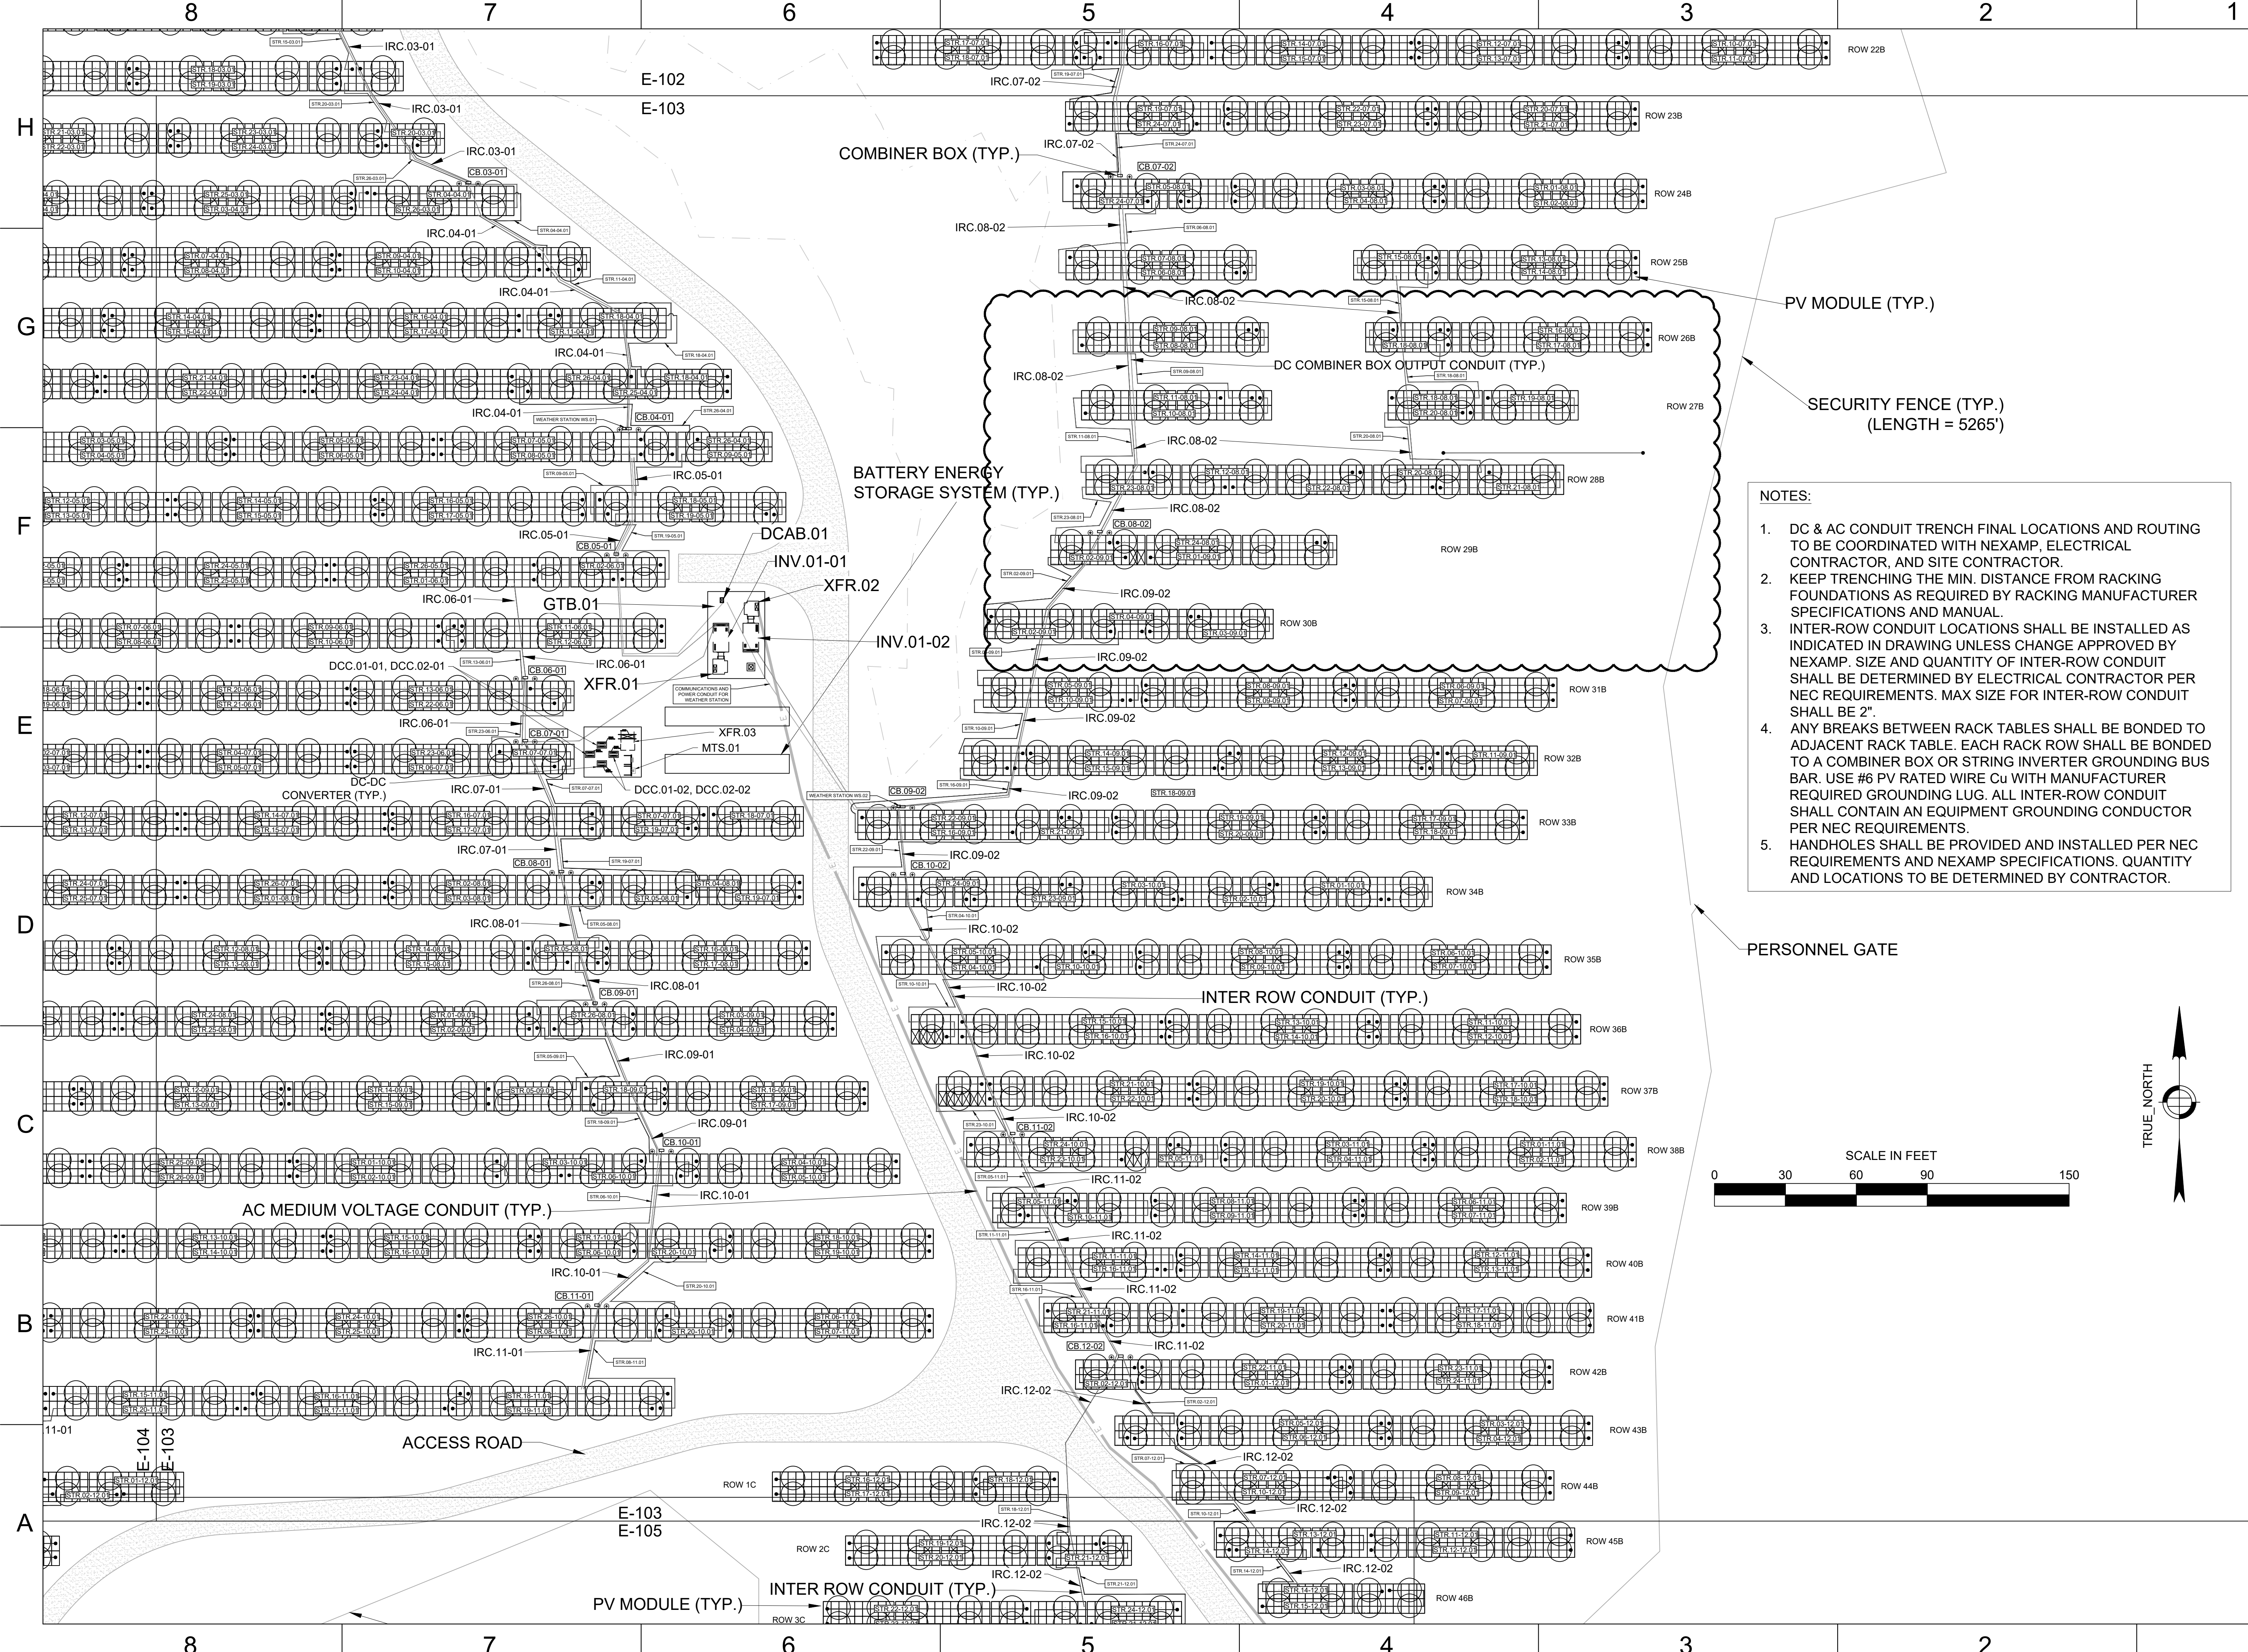

PV MODULE (TYP.)

SECURITY FENCE (TYP.)
(LENGTH = 5265')

- NOTES:**
- DC & AC CONDUIT TRENCH FINAL LOCATIONS AND ROUTING TO BE COORDINATED WITH NEXAMP, ELECTRICAL CONTRACTOR, AND SITE CONTRACTOR.
 - KEEP TRENCHING THE MIN. DISTANCE FROM RACKING FOUNDATIONS AS REQUIRED BY RACKING MANUFACTURER SPECIFICATIONS AND MANUAL.
 - INTER-ROW CONDUIT LOCATIONS SHALL BE INSTALLED AS INDICATED IN DRAWING UNLESS CHANGE APPROVED BY NEXAMP. SIZE AND QUANTITY OF INTER-ROW CONDUIT SHALL BE DETERMINED BY ELECTRICAL CONTRACTOR PER NEC REQUIREMENTS. MAX SIZE FOR INTER-ROW CONDUIT SHALL BE 2".
 - ANY BREAKS BETWEEN RACK TABLES SHALL BE BONDED TO ADJACENT RACK TABLE. EACH RACK ROW SHALL BE BONDED TO A COMBINER BOX OR STRING INVERTER GROUNDING BUS BAR. USE #6 PV RATED WIRE Cu WITH MANUFACTURER REQUIRED GROUNDING LUG. ALL INTER-ROW CONDUIT SHALL CONTAIN AN EQUIPMENT GROUNDING CONDUCTOR PER NEC REQUIREMENTS.
 - HANDHOLES SHALL BE PROVIDED AND INSTALLED PER NEC REQUIREMENTS AND NEXAMP SPECIFICATIONS. QUANTITY AND LOCATIONS TO BE DETERMINED BY CONTRACTOR.

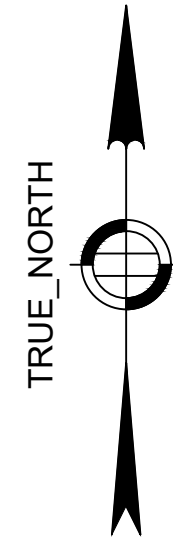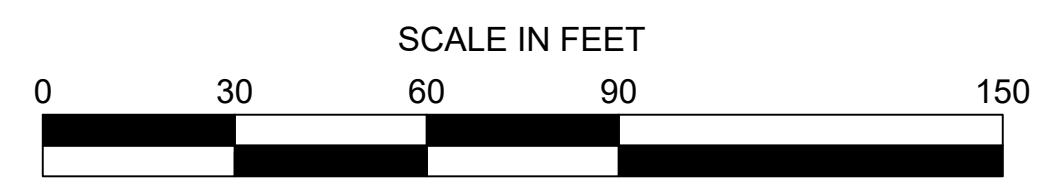

101 Summer Street, Boston, MA 02110
Tel: (617) 431-1440 Fax: (978) 416-2925 Web: nexamp.com

Rev	Issued For	Date
A	Bid Set	10/16/2019
B	Permit Set	10/25/2019
C	Construction Set	12/5/2019
D	Construction Set	03/03/2020
E	Construction Set	08/12/2020
F	Construction Set	09/11/2020
G	Construction Set	10/14/2020

P. E. seal/Consultant:

Project: **06428**
Conway Solar LLC.
2394 Main Poland Road
Conway, MA 01341

Drawing Title: **Electrical Site Plan (Section 2)**
Drawn by: L. Kamguia Scale: 1" = 30' Approved by: S. Perranca

Dwg No: **E-103** Size: **D** Sheet Rev: **G**

Company Confidential - This drawing or print is the property of Nexamp, Inc. and is subject to return on request. The design concepts and information contained herein are proprietary to Nexamp, Inc. and its subsidiaries and are submitted in confidence. They are not transferable and must be used only for the purpose for which the Drawing/print is expressly loaned. They must not be disclosed, reproduced detrimental to the interest of Nexamp, Inc. All patent rights are reserved unless they are expressly assigned in writing by a duly authorized representative of Nexamp, Inc.